



POWER SAVING DEVICE MECHANISM


Installation Method

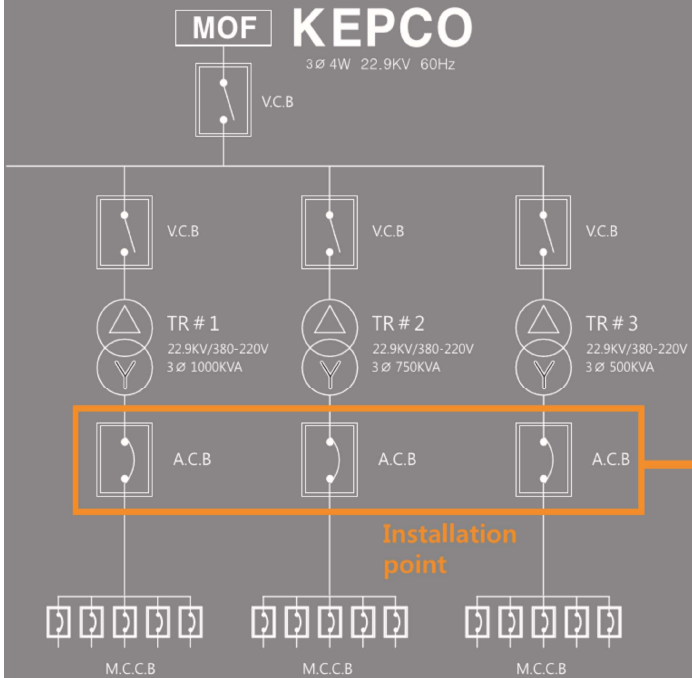

★ **Installation place**
Parallel connection to each R,S,T,N node, 2nd A,C,B main circuit breaker.

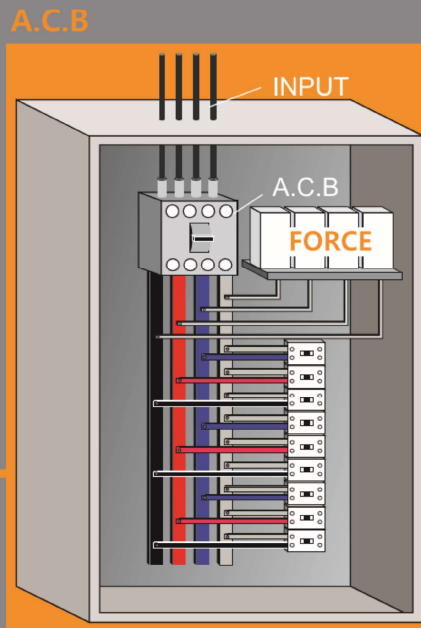

★ Installing at the inside of the super minimize A,C,B panel

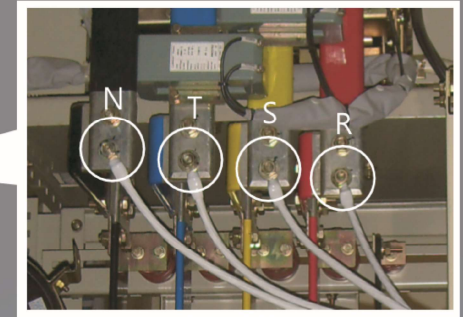

★ It is safe and simple installation at each R,S,T,N note R,S,T,N requiring 30 minutes.

